

Technical Report No.: 64.181.20.03467.01 Rev.00

Date: 2020-07-31

Client: Name: Guangzhou Sprsun New Energy Technology Development Co., Ltd  
Address: No.15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng District,Guangzhou,511338, China

Contact person: YE XIN

Manufacturing place: Manufacturer's name: Guangzhou Sprsun New Energy Technology Development Co., Ltd  
Address: No.15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng District,Guangzhou,511338, China

Factory's name: Guangzhou Sprsun New Energy Technology Development Co., Ltd  
Address: No.15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng District,Guangzhou,511338, China

Test subject: Product: DC Inverter Heat Pump  
Type: CGK-060V2, CGK-060V2S

Trade name: SPRSUN

Test specification:  EN 14825:2018  
 (EU) No 813/2013

Purpose of examination: Test according to the test specification  
 EU 2016/2282:2016-11-30

Test result: The test results show that the presented product is in compliance with the specified requirements

Any use for advertising purposes must be granted in writing. This technical report may only be quoted in full. This report is the result of a single examination of the object in question and is not generally applicable evaluation of the quality of other products in regular production. For further details please see testing and certification regulation, chapter A-3.4.

Doc No.: ITC-TTW0902.02E – Rev.7

## 1 Description of the test subject

### 1.1 Function

Manufacturer's specification for intended use:

The appliance is air to water heat pump.

Manufacturer's specification for predictive use:

According to user manual

### 1.2 Consideration of the foreseeable use

- Not applicable
- Covered through the applied standard
- Covered by the following comment
- Covered by attached risk analysis

### 1.3 Technical Data

Model :	CGK-060V2, CGK-060V2S
Rated Voltage (V) :	380-415, 3N~
Rated Frequency (Hz) :	50
Rated Power (W) :	7150
Rated Current (A) :	13.5
Protection Class :	Class I
Protection Against Moisture :	IP X4
Construction :	Stationary
Supply connection :	<input type="checkbox"/> Non detachable cord <input checked="" type="checkbox"/> Permanent connection to fixed wiring
Operation mode:	<input checked="" type="checkbox"/> Continuous operation; <input type="checkbox"/> Intermittent operation; <input type="checkbox"/> Short time operation;
Refrigerant/charge (g) :	R410A /3200g
Declared parameters :	<input checked="" type="checkbox"/> Average <input type="checkbox"/> Warmer <input type="checkbox"/> Colder
Sound power level dB(A) :	N/A
Series No :	KRZH04A20600400017

## 2 Order

### 2.1 Date of Purchase Order, Customer's Reference

2020-07-23, YE XIN

### 2.2 Receipt of Test Sample, Condition, Location

2020-07-23

For Energy test:

GZ-Lans Experimental Technology Co., Ltd. Laboratory

Address: Room F2, No.10, Mubei East Road, Xintang Street, Tianhe District, Guangzhou, Guangdong, China

### 2.3 Date of Testing

2020-07-23 to 2020-07-31

### 2.4 Location of Testing

Same as 2.2

### 2.5 Points of Non-compliance or Exceptions of the Test Procedure

N/A

## 3 Test Results

### 3.1 Positive Test Results

See Appendix I

## 4 Remark

N/A

**4.1** The user manual has been examined according to the minimum requirements described in the product standard. The manufacturer is responsible for the accuracy of further particulars as well as of the composition and layout.

**4.2** When the product is placed on the market, it must be accompanied with safety Instructions written in official language of the country. The instructions shall give information regarding safe operation, installation and maintenance.

## 5 Documentation

- Appendix I Test results
- Appendix II Marking plate
- Appendix III photo documentation
- Appendix IV Construction data form
- Appendix V Test equipment list

**6 Summary**

- 1) The appliance is DC Inverter Type Air To Water Unit , including a whole compression type refrigerant circuit to heat water in another circuit. The appliance was for cooling and heating water function, this report only for heating capacity test.
- 2) The main power is supplied by a 5-pole supply cable not with plug which not supply by manufactory.
- 3) Water enthalpy method was adopted in this report.
- 4) Standby mode power, off mode power and thermostat-off mode power were tested according to clause 12 of standard EN 14825:2018.
- 5) The model CGK-060V2 is same as CGK-060V2S except for model's name. And the test are carried out at models CGK-060V2.

**TÜV SÜD Certification and Testing (China) Co., Ltd. Guangzhou Branch  
TÜV SÜD Group**

Tested by: William Liang, Project Handler

*printed name, function & signature*

Approved by: Tony Xie, Designated Reviewer

*printed name, function & signature*



**Appendix I Test results**

<b>Table 1.</b>	<b>Heating mode(Low temperature application):</b>						<b>P</b>
<b>Model</b>	CGK-060V2						
<b>Product type</b>	Air to Water	<b>Heating season</b>	<input checked="" type="checkbox"/> Average	<input type="checkbox"/> Warmer	<input type="checkbox"/> Colder		
<b>1. Test conditions:</b>							
<b>Condition</b>	<b>Part Load Ratio</b> in %				<b>Outdoor heat exchanger</b>	<b>Indoor heat exchanger</b>	
	Formula	A	W		Inlet dry (wet) bulb temperature °C	Inlet/outlet water temperatures (°C)	
A	$(-7-16)/(T_{designh-16})$	88	N/A	N/A	-7(-8)	a / 34	
B	$(+2-16)/(T_{designh-16})$	54	N/A	N/A	2(1)	a / 30	
C	$(+7-16)/(T_{designh-16})$	35	N/A	N/A	7(6)	a / 27	
D	$(+12-16)/(T_{designh-16})$	15	N/A	N/A	12(11)	a / 24	
E	$(TOL-16)/(T_{designh-16})$				TOL	a / 35.3	
F	$(T_{bivalent-16})/(T_{designh-16})$				T <sub>biv</sub>	a / 34	
G	$(-15-16)/(T_{designh-16})$	N/A	N/A	N/A	-15	N/A	
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 30/35 conditions.							
<b>2. Tested data/correction data(Average):</b>							
General test conditions/ Part-Load	Unit	A(-7)/W34 (88%)	A2/W30 (54%)	A7/W27 (35%)	A12/W24 (15%)	A(-10)/W35.3 (100%)	A(-7)/W34 (88%)
	--	A	B	C	D	E	F
Data collection period	hh: min:sec	4:00:00	3:00:00	2:00:00	2:00:00	4:00:00	4:00:00
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes
Complete Cycles	--	2	0	0	0	1	2
Barometric pressure	kPa	101.02	101.02	101.02	101.02	101.02	101.02
Voltage	V	407.2	406.8	406.2	407.3	403.2	407.2
Current input of the unit	A	8.13	3.45	3.20	2.90	8.35	8.13
Power input of the unit	kW	3.790	1.424	1.332	1.043	3.766	3.790
Test conditions <b>indoor</b> unit							
<b>Inlet</b> Water temperature, DB	°C	28.40	26.49	22.65	19.26	29.73	28.40
<b>Outlet</b> Water temperature, DB	°C	33.56	29.91	27.08	24.01	34.47	33.56

Doc No.: ITC-TTW0902.02E – Rev.7

**Appendix I Test results**

Test conditions outdoor unit							
Air inlet temperature, DB	°C	-6.76	2.10	7.01	12.00	-10.23	-6.76
Air inlet temperature, WB	°C	-7.77	1.13	6.00	11.00	-11.31	-7.77
Summary of the results							
Total heating capacity	kW	10.772	7.172	9.293	9.967	9.901	10.772
Effective power input	kW	3.857	1.491	1.399	1.110	3.833	3.857
Coefficient of performance (COP)	--	2.79	4.81	6.64	8.98	2.58	2.79
Compressor frequency	Hz	78	33	33	33	78	78
Water flow	m³/h	1.80	1.80	1.80	1.80	1.80	1.80
Remark: * In part condition, outlet temperature data is recorded by a full average complete cycle's data.							
3.Calculation/conclusion for SCOP(Average):							
Tdesignh(°C)	-10	Tbiv(°C)		-7			
Pdesignh(kW)	12.177	TOL(°C)		-10			
Test result A, B, C, D, E, F conditions:							
Condition	Part load	Measured capacity	COP at measured capacity	Cdh	CR	COP at part load	
E	12.177	9.901	2.58	0.00	1.00	2.58	
F	10.772	10.772	2.79	0.00	1.00	2.79	
A	10.772	10.772	2.79	0.00	1.00	2.79	
B	6.557	7.172	4.81	0.00	0.91	4.81	
C	4.215	9.293	6.64	0.99	0.45	6.57	
D	1.873	9.967	8.98	0.99	0.19	8.61	
CR: part load divided by capacity;							

Doc No.: ITC-TTW0902.02E – Rev.7

**Appendix I Test results**

Electric power consumptions	Unit	Value
Thermostat-off mode [ $P_{TO}$ ]	kW	0.014
Standby mode [ $P_{SB}$ ]	kW	0.014
Crankcase heater [ $P_{CK}$ ]	kW	0.040
Off mode [ $P_{OFF}$ ]	kW	0.014

Conclusions:	Unit	Value
SCOP <sub>on</sub> :	kWh/kWh	4.88
SCOP:	kWh/kWh	4.87
$Q_H$ :	kWh/year	25158
$Q_{HE}$ :	kWh/year	5167
$\eta_{s,h}$	%	191.8
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 2)	--	A+++

Doc No.: ITC-TTW0902.02E -- Rev.7

Appendix I Test results

<b>Table 2.</b>	<b>Heating mode(Medium temperature application):</b>						<b>P</b>
<b>Model</b>	CGK-060V2						
<b>Product type</b>	Air to Water	<b>Heating season</b>	<input checked="" type="checkbox"/> Average	<input type="checkbox"/> Warmer	<input type="checkbox"/> Colder		
<b>1. Test conditions:</b>							
<b>Condition</b>	<b>Part Load Ratio</b> in %				<b>Outdoor heat exchanger</b>	<b>Indoor heat exchanger</b>	
	Formula	A	W	C	Inlet dry (wet) bulb temperature °C	Inlet/outlet water temperatures (°C)	
A	$(-7-16)/(T_{designh-16})$	88	N/A	N/A	-7(-8)	a / 52	
B	$(+2-16)/(T_{designh-16})$	54	N/A	N/A	2(1)	a / 42	
C	$(+7-16)/(T_{designh-16})$	35	N/A	N/A	7(6)	a / 36	
D	$(+12-16)/(T_{designh-16})$	15	N/A	N/A	12(11)	a / 30	
E	$(TOL-16)/(T_{designh-16})$				TOL	a / 55.3	
F	$(T_{bivalent-16})/(T_{designh-16})$				Tbiv	a / 52	
G	$(-15-16)/(T_{designh-16})$	N/A	N/A	N/A	-15	N/A	
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 47/55 conditions.							
<b>2. Tested data/correction data(Average):</b>							
General test conditions/ Part-Load	Unit	A(-7)/W52 (88%)	A2/W42 (54%)	A7/W36 (35%)	A12/W30 (15%)	A(-10)/W55.3 (100%)	A(-7)/W52 (88%)
	--	A	B	C	D	E	F
Data collection period	hh: min:sec	4:00:00	2:00:00	2:00:00	2:00:00	4:00:00	4:00:00
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes
Complete Cycles	--	1	0	0	0	1	1
Barometric pressure	kPa	101.02	101.02	101.02	101.02	101.02	101.02
Voltage	V	405.8	408.3	403.9	405.4	405.3	405.8
Current input of the unit	A	10.06	4.08	3.64	2.99	10.25	10.06
Power input of the unit	kW	4.902	1.649	1.404	1.131	4.957	4.902
Test conditions <b>indoor</b> unit							
<b>Inlet</b> Water temperature, DB	°C	43.87	37.79	31.13	24.38	47.70	43.87
<b>Outlet</b> Water temperature, DB	°C	51.00	41.95	36.00	30.01	54.06*	51.00

Doc No.: ITC-TTW0902.02E – Rev.7



**Appendix I Test results**

Test conditions outdoor unit							
Air inlet temperature, DB	°C	-6.56	2.00	7.01	12.02	-9.75	-6.56
Air inlet temperature, WB	°C	-7.57	1.00	6.00	11.00	-10.74	-7.57
Summary of the results							
Total heating capacity	kW	10.681	6.191	7.273	8.441	9.660	10.681
Effective power input	kW	4.927	1.674	1.429	1.156	4.982	4.927
Coefficient of performance (COP)	--	2.17	3.70	5.09	7.30	1.94	2.17
Compressor frequency	Hz	78	30	30	30	78	78
Water flow	m <sup>3</sup> /h	1.29	1.29	1.29	1.29	1.29	1.29
Remark: * In part condition, outlet temperature data is recorded by a full average complete cycle's data.							
3.Calculation/conclusion for SCOP(Average):							
Tdesignh(°C)	-10	Tbiv(°C)		-7			
Pdesignh(kW)	12.075	TOL(°C)		-10			
Test result A, B, C, D, E, F conditions:							
Condition	Part load	Measured capacity	COP at measured capacity	Cdh	CR	COP at part load	
E	12.075	9.660	1.94	0.00	1.00	1.94	
F	10.681	10.681	2.17	0.00	1.00	2.17	
A	10.681	10.681	2.17	0.00	1.00	2.17	
B	6.502	6.191	3.70	0.00	1.00	3.70	
C	4.180	7.273	5.09	0.99	0.57	5.05	
D	1.858	8.441	7.30	0.99	0.22	7.05	
CR: part load divided by capacity;							




Doc No.: ITC-TTW0902.02E – Rev.7

**Appendix I Test results**

Electric power consumptions	Unit	Value
Thermostat-off mode [ $P_{TO}$ ]	kW	0.015
Standby mode [ $P_{SB}$ ]	kW	0.015
Crankcase heater [ $P_{CK}$ ]	kW	0.039
Off mode [ $P_{OFF}$ ]	kW	0.051

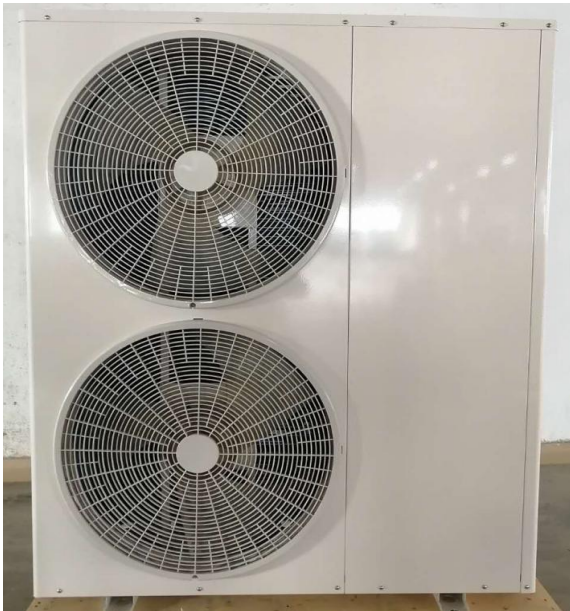
Conclusions:	Unit	Value
SCOP <sub>on</sub> :	kWh/kWh	3.65
SCOP:	kWh/kWh	3.65
$Q_H$ :	kWh/year	24946
$Q_{HE}$ :	kWh/year	6842
$\eta_{s,h}$	%	142.8
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 1)	--	A++

Appendix II Marking plate

Nameplate	
Model: <u>CGK-060V2</u>	
  	
<b>DC Inverter Air Source Heat Pumps</b>	
Model	CGK-060V2
Heating Capacity Min./Max.	8.56/18.6kW
Heating Input Power Min./Max.	1.55/4.21kW
Cooling Capacity Min./Max.	6.03/13.11kW
Cooling Input Power Min./Max.	1.67/5.26kW
Power Supply	380V-415V/50Hz
Shock Proof Grade	I
WaterProof Level	IPX4
Rated Input Power	7.15kW
Rated Input Current	13.5A
Max. Water Outlet Temperature	55°C
Water Flow	2m <sup>3</sup> /h
Refrigerant/Weight	R410A/3200g
Water Pressure Drop	25kPa
Water Pipe Connection	1 inch
Max Water Pressure	1.0MPa
Net Weight	124kg
Date	See bar code
NO.	See bar code
<b>Guangzhou Sprsun New Energy Technology Development Co., Ltd</b> <b>No. 15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng</b>	
Remark: The model CGK-060V2 is same as CGK-060V2S except for model's name.	

Doc No.: ITC-TTW0902.02E – Rev.7


Appendix III photo documentaiton

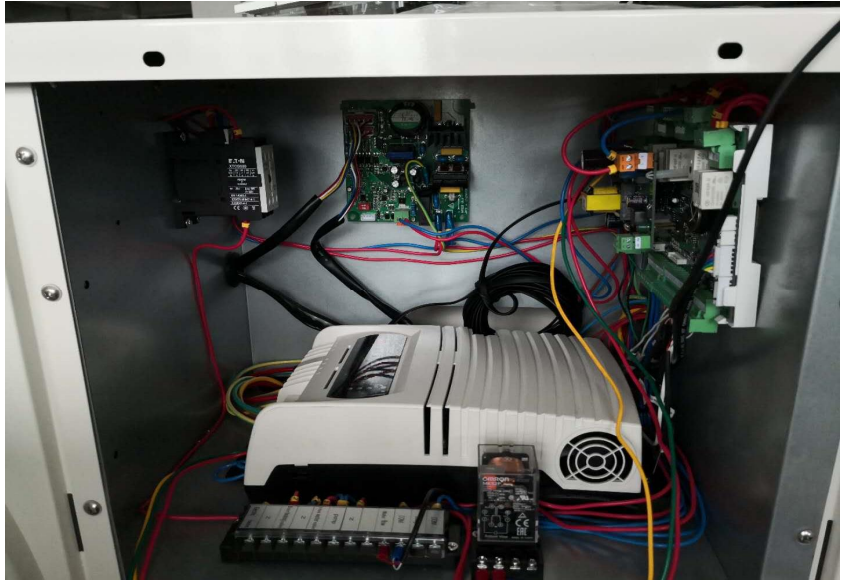
Details of:	Overall view
<p><b>View:</b></p> <p><input type="checkbox"/> General</p> <p><input type="checkbox"/> Front</p> <p><input type="checkbox"/> Rear</p> <p><input type="checkbox"/> Right</p> <p><input type="checkbox"/> Left</p> <p><input type="checkbox"/> Top</p> <p><input type="checkbox"/> Bottom</p>	

Details of:	Compressor
<p><b>View:</b></p> <p><input type="checkbox"/> General</p> <p><input type="checkbox"/> Front</p> <p><input type="checkbox"/> Rear</p> <p><input type="checkbox"/> Right</p> <p><input type="checkbox"/> Left</p> <p><input type="checkbox"/> Top</p> <p><input type="checkbox"/> Bottom</p>	

Doc No.: ITC-TTW0902.02E – Rev.7

Appendix III photo documentaiton

Details of:	Fan Motor
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Details of:	Main Control Board
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E – Rev.7

**Appendix IV Construction data form**

Model: <u>CGK-060V2</u>		
Part		Technical data
1. Compressor		
	Manufacture:	Panasonic Wanbao Appliances Compressor (Guangzhou) Co., Ltd.
	Type:	5VD420ZBA21
	Rated capacity:	4220W; R410A
	Serial-number:	N/A
2. Condenser		
	Manufacture:	East -Alliance Thermal Equipment
	Type:	EATB61-D-40-2M-2L
	Heat exchanger:	Plate heat exchanger
	Dimension (mm):	539(L)mmX125(H)mmX103(D)mm
3. Evaporator		
	Manufacture:	Guangzou Aotai Refrigeration EquipmentCo.,Ltd.
	Type:	A105004-CP-01
	Heat exchanger:	Finned-coil heat exchanger
	Dimension (mm):	660(L)mmX1300(H)mmX345(D)mm
4. Fan motor		
	Manufacture:	Wolong Electric Group Co., Ltd
	Type:	ZWB278D04A
	Fan type:	3 blade
5. Main control board		
	Manufacture:	CAREL
	Type:	UP3CON0S00
	Specification:	380-420V; 50Hz

Doc No.: ITC-TTW0902.02E – Rev.7

**Appendix V Equipment List**

No.	Type	Manufacture	Model	Equipment ID	Calibration Due Date
1	R&A performance measuring system	GEI	20kW	-	2020-08-03
2	Temperature and humidity meter	VAISALA	HMD42	H5110021	2020-08-03
3	Platinum resistance	YINUO	Pt100	7430F	2021-05-21
4	Platinum resistance	YINUO	Pt100	7434F	2021-05-21
5	Flowmeter	YOKOGAWA	AXF015G	S5M201965	2021-05-21
6	Flowmeter	YOKOGAWA	AXF040G	S5M805005	2021-05-21
7	Pressure transmitter	MICRO	MPM489	240502	2020-08-04
8	Pressure transmitter	MICRO	MPM489	240503	2020-08-04
9	Water pressure difference transmitter	MICRO	MDM3051	291459	2020-08-04
10	AC source Supply	YANGHONG	YF-3600	-	2021-01-01
11	Water pressure difference transmitter	MICRO	MDM3051	291459	2020-08-04
12	AC source Supply	YANGHONG	YF-3600	-	2021-01-01
13	Temperature and humidity meter	H5110021	HMD42	VAISALA	2020-08-04

-- End of Report --